

Handrails Within Dwelling Units

Guideline

Guideline ESP- 08

Purpose

This guideline has been developed to help improve consistency with the installation, education and enforcement of a handrails installed in dwelling units for new or renovated construction.



Code Reference

National Building Code – 2019 Alberta Edition Division B Section 9.8.7.2.
2014 Illustrated Users Guide – NBC 2015 Part 9 Housing and Small Buildings 9.8.7.2.



Conclusion

This Guideline provides clarity and direction from Rocky View County on their interpretation on continuity of handrails and what this means for a dwelling unit. Based on the information provided within this Guideline, continuous handrails should be installed in the following method(s).

1. Continuity of Handrails – For stairs or ramps serving a single dwelling unit, handrails must be continuously graspable throughout the length of the stair, except where interrupted by a doorway, landing or newel post.

This means that where you have a stairway that includes a landing between one or more flights of stairs, a handrail must be provided along each flight of stairs so that the entire length of stair from one floor level to the next floor level has a handrail. Handrails must be installed:

- a) from the bottom riser to the top riser, and
- b) along all flights of stairs no matter how many risers.


2. Required handrails – A single handrail is required for stairs within a dwelling unit which have more than 2 risers. There is no maximum width were an additional handrail would be required.
3. Length of Flight – **Length of Flight** means a continuous series of steps from one landing or floor level to the next landing or floor level, containing not less than three risers. For handrails and ramps serving a single dwelling unit, handrails must be continuously graspable throughout the length of flights of stairs, from the bottom riser to the top riser.
4. Length of Stair – **Length of Stair** means a series of steps which are continuous throughout the stair, including landings. For handrails and ramps serving occupancies other than dwelling units,

Handrails Within Dwelling Units


handrails must be continuously graspable throughout the length of the stair including the landing.

5. Guardrails – Handrails are required to be continuous through-out the stair, and should not terminate above the bottom riser, or below the top riser. Where a second handrail is not required, and the total height from the step is not greater than 600 mm (2 feet), a guardrail can be omitted.

Illustrations

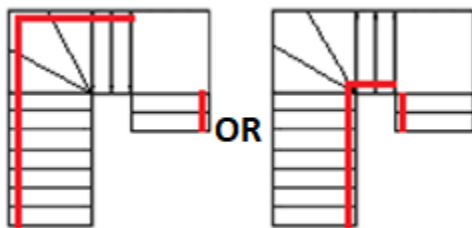

Handrail required throughout the total length of the stair, from bottom riser to top riser including the winders.

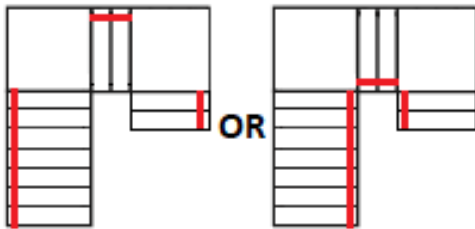

Handrail required along the length of the flight of the stair. The handrail can be interrupted by the landing.



Handrail required on one side throughout flight of stair. Where the bottom open side is less than 600 mm to floor level, no guardrail is required.



Reference

Approval Date

- August, 2020

Last Review Date

- August, 2020