




Uncovered Deck - Application Detail Sheet

NOTES:

- The guards must be non-climbable with no horizontal rails, fixed benches or other items that would provide a foothold.
- If the floor to adjacent grade distance is between 2'-0" & 6'-0" the guard height can be 36", over 6'-0" requires a 42" height guard.
- Only one handrail is required on one side of an exterior stair, and is required to be a minimum of 36" high.
- If a roof structure or other enclosure will be constructed, permanent foundations such as larger footings or concrete walls may be required. Additional detailed drawings must be provided for review.

MAXIMUM FRAMING SPANS		
Joist	16" spacing S-P-F	24" spacing S-P-F
2x6	9'-0"	8'-0"
2x8	11'-6"	10'-9"
2x10	13'-6"	13'-0"
Post Spacing	Joist Span	Beam Type S-P-F
6'-0"	8'-0"	2 - 2x6
	9'-0"	2 - 2x6
	10'-0"	2 - 2x6
	11'-0"	2 - 2x6
	12'-0"	2 - 2x6
	14'-0"	2 - 2x6
8'-0"	8'-0"	2 - 2x8
	9'-0"	2 - 2x8
	10'-0"	2 - 2x8
	11'-0"	2 - 2x8
	12'-0"	2 - 2x8
	14'-0"	2 - 2x10

Note: Framing outside this table req's either code span tables or CWC Span Tables

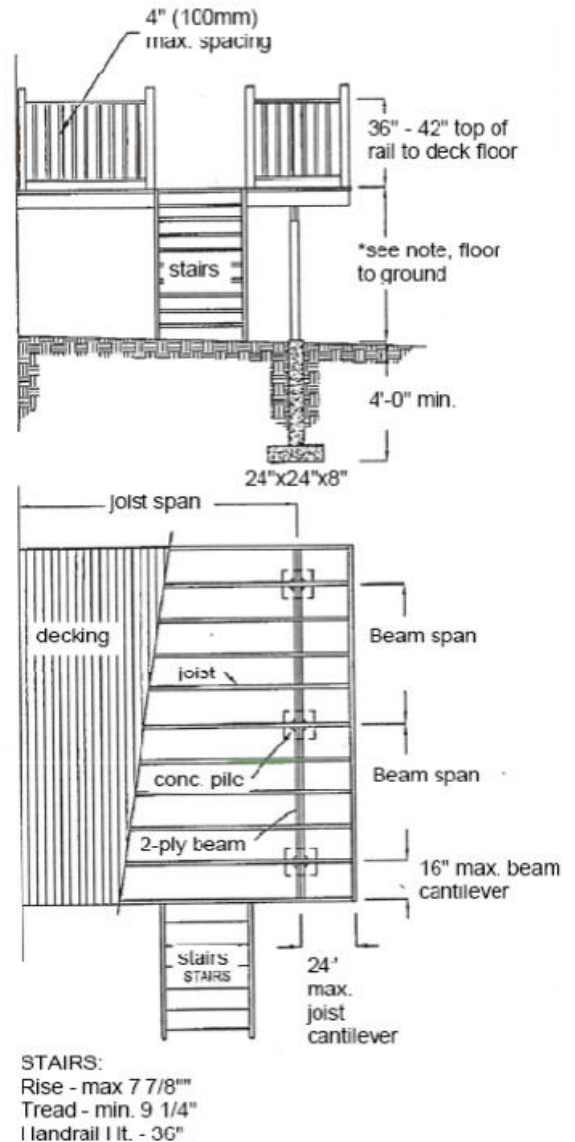

DECK CONSTRUCTION DETAILS		Rocky View County	
Deck Floor height above grade	_____	<div style="text-align: center;">Building Inspector</div> <hr/> <div style="text-align: center;">Date</div> <hr/> <div style="text-align: center;">Building Permit Number</div>	
Joist Size and spacing	_____		
Beam size and post spacing	_____		
Guardrail & handrail height	_____		